


Single Relay Example

If You Are Not Sure Please Ask

Do Not Scale Drawing

METRIC

Rover Max Controller Electrical Installation Example

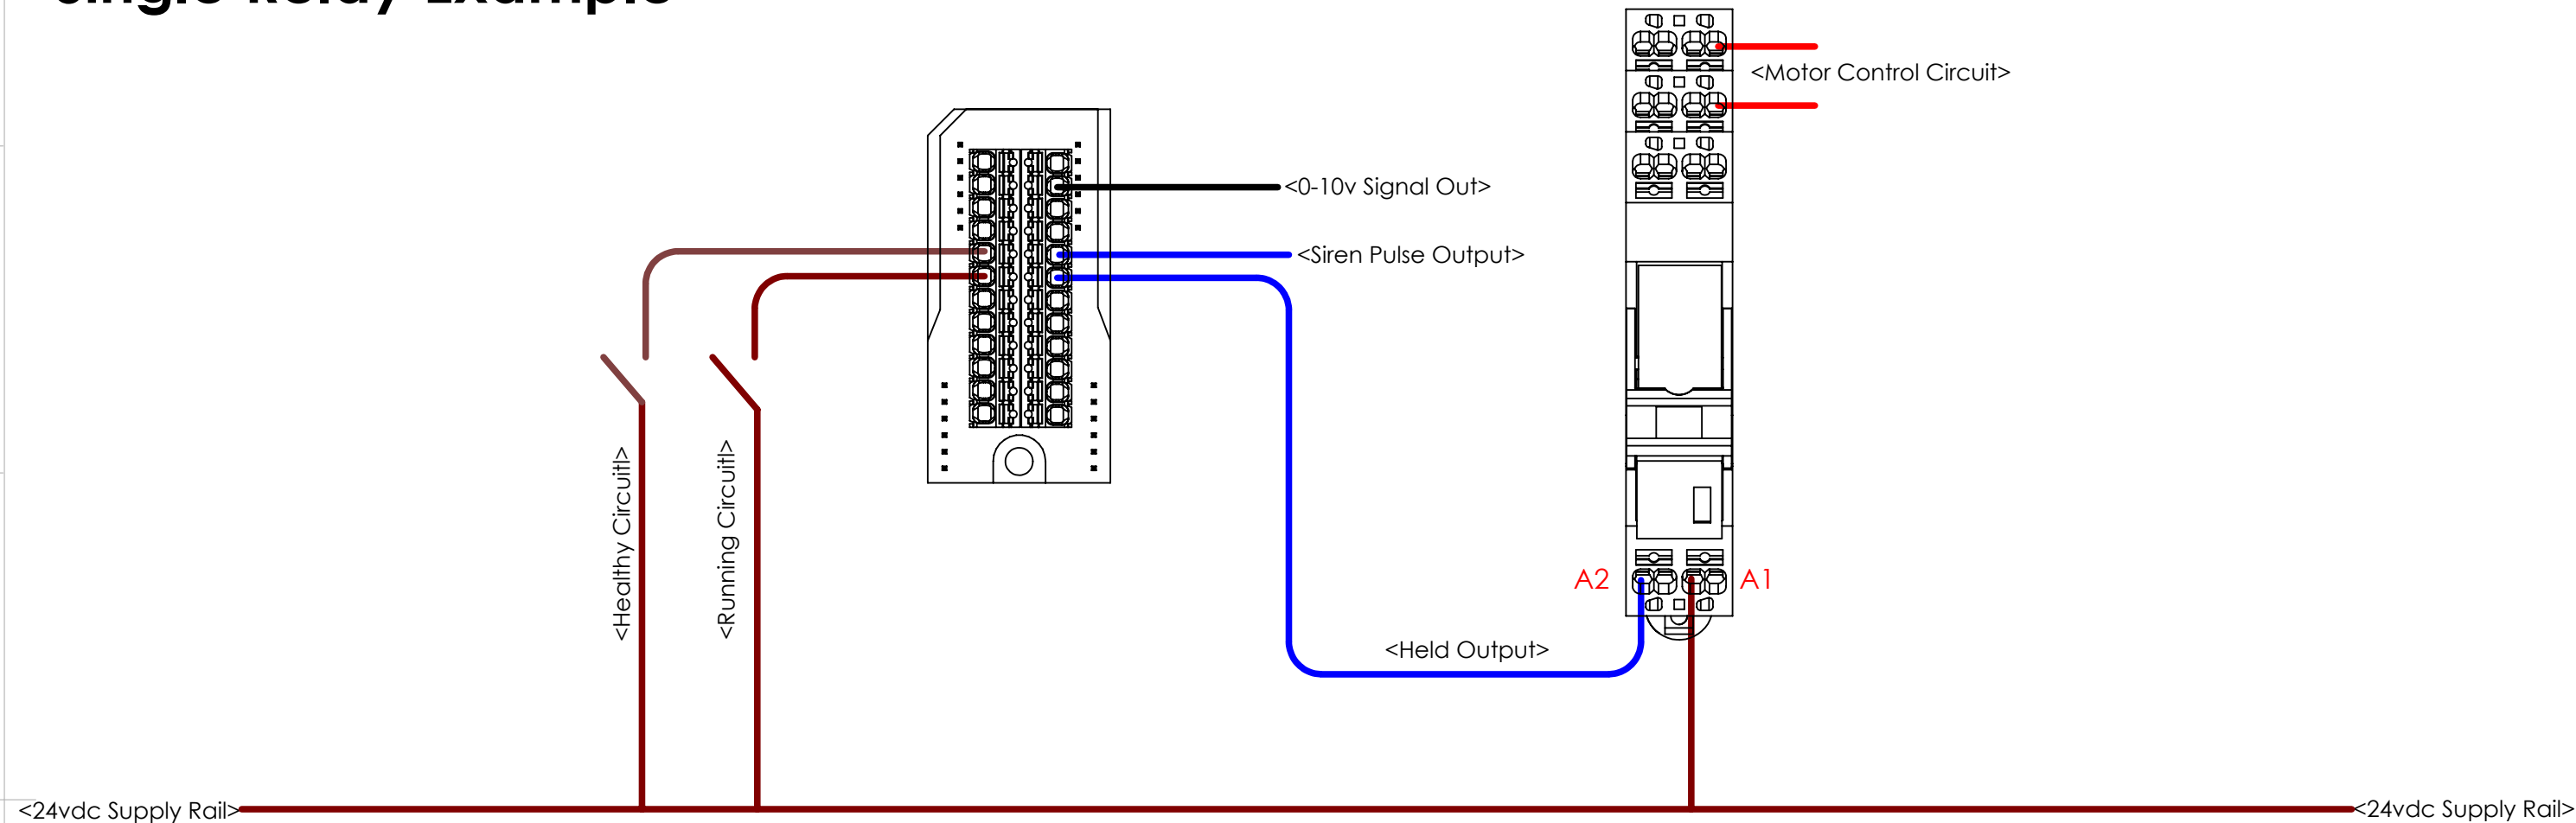

A1 - High Side of Coil
A2 - Low Side Of Coil



Motor Control - wired Normally Open, On activation Held Output is Switched.

Healthy Circuit Must be High for system control to activate
Running Circuit must be High for system to continue running after start command

0-10v signal circuit can be used in VFD application.

Rover Systems Pump Modem Max
4g Pump Modem - Electrical Installation Example
Single Relay Held Control Example

Designed and Manufactured by Rover Systems Pty Ltd

Change Notes:		CHANGE DOC.		CD/REC		CHANGE DATE					
Rover Max Controller Electrical Installation Example				CD/APPV							
				CD/CHK							
WEIGHT: kg.						COPYRIGHT - ALL RIGHTS RESERVED This drawing is the property of Rover Systems Pty Ltd, 8 Maisie Place Ulverstone Tasmania and is not to be copied or used in part or whole without the authority of Rover Systems Pty Ltd This drawing is to be returned to Rover Systems Pty Ltd on demand.					
MATERIAL:											
SPECIFICATION:											
Thickness		<div>TOLERANCES</div> <div>X = +/- 1.5</div> <div>X.X = +/- 0.8</div> <div>X.XX = +/- 0.25</div> <div>ANG = +/- 1DEG</div>		DO NOT SCALE DRAWING		SHEET 1 OF 1		DATE: 1/01/2025			
FINISH:								REVISION:			
PROFILE DWG:											
TOOLING DWG:											
PARENT DWG:											
STATUS		DESCRIPTION:		DRAWN		CHG		VER		SHT	
				APPV'D							
				CHK'D							
										A3	